


# Fire Station Location Allocation Network Analysis

Based on NFPA 1710 Standard, drive time no longer than 6 minutes for Structure Fire calls  
 1 minute railroad track impediments  
 Proposed development demand points included

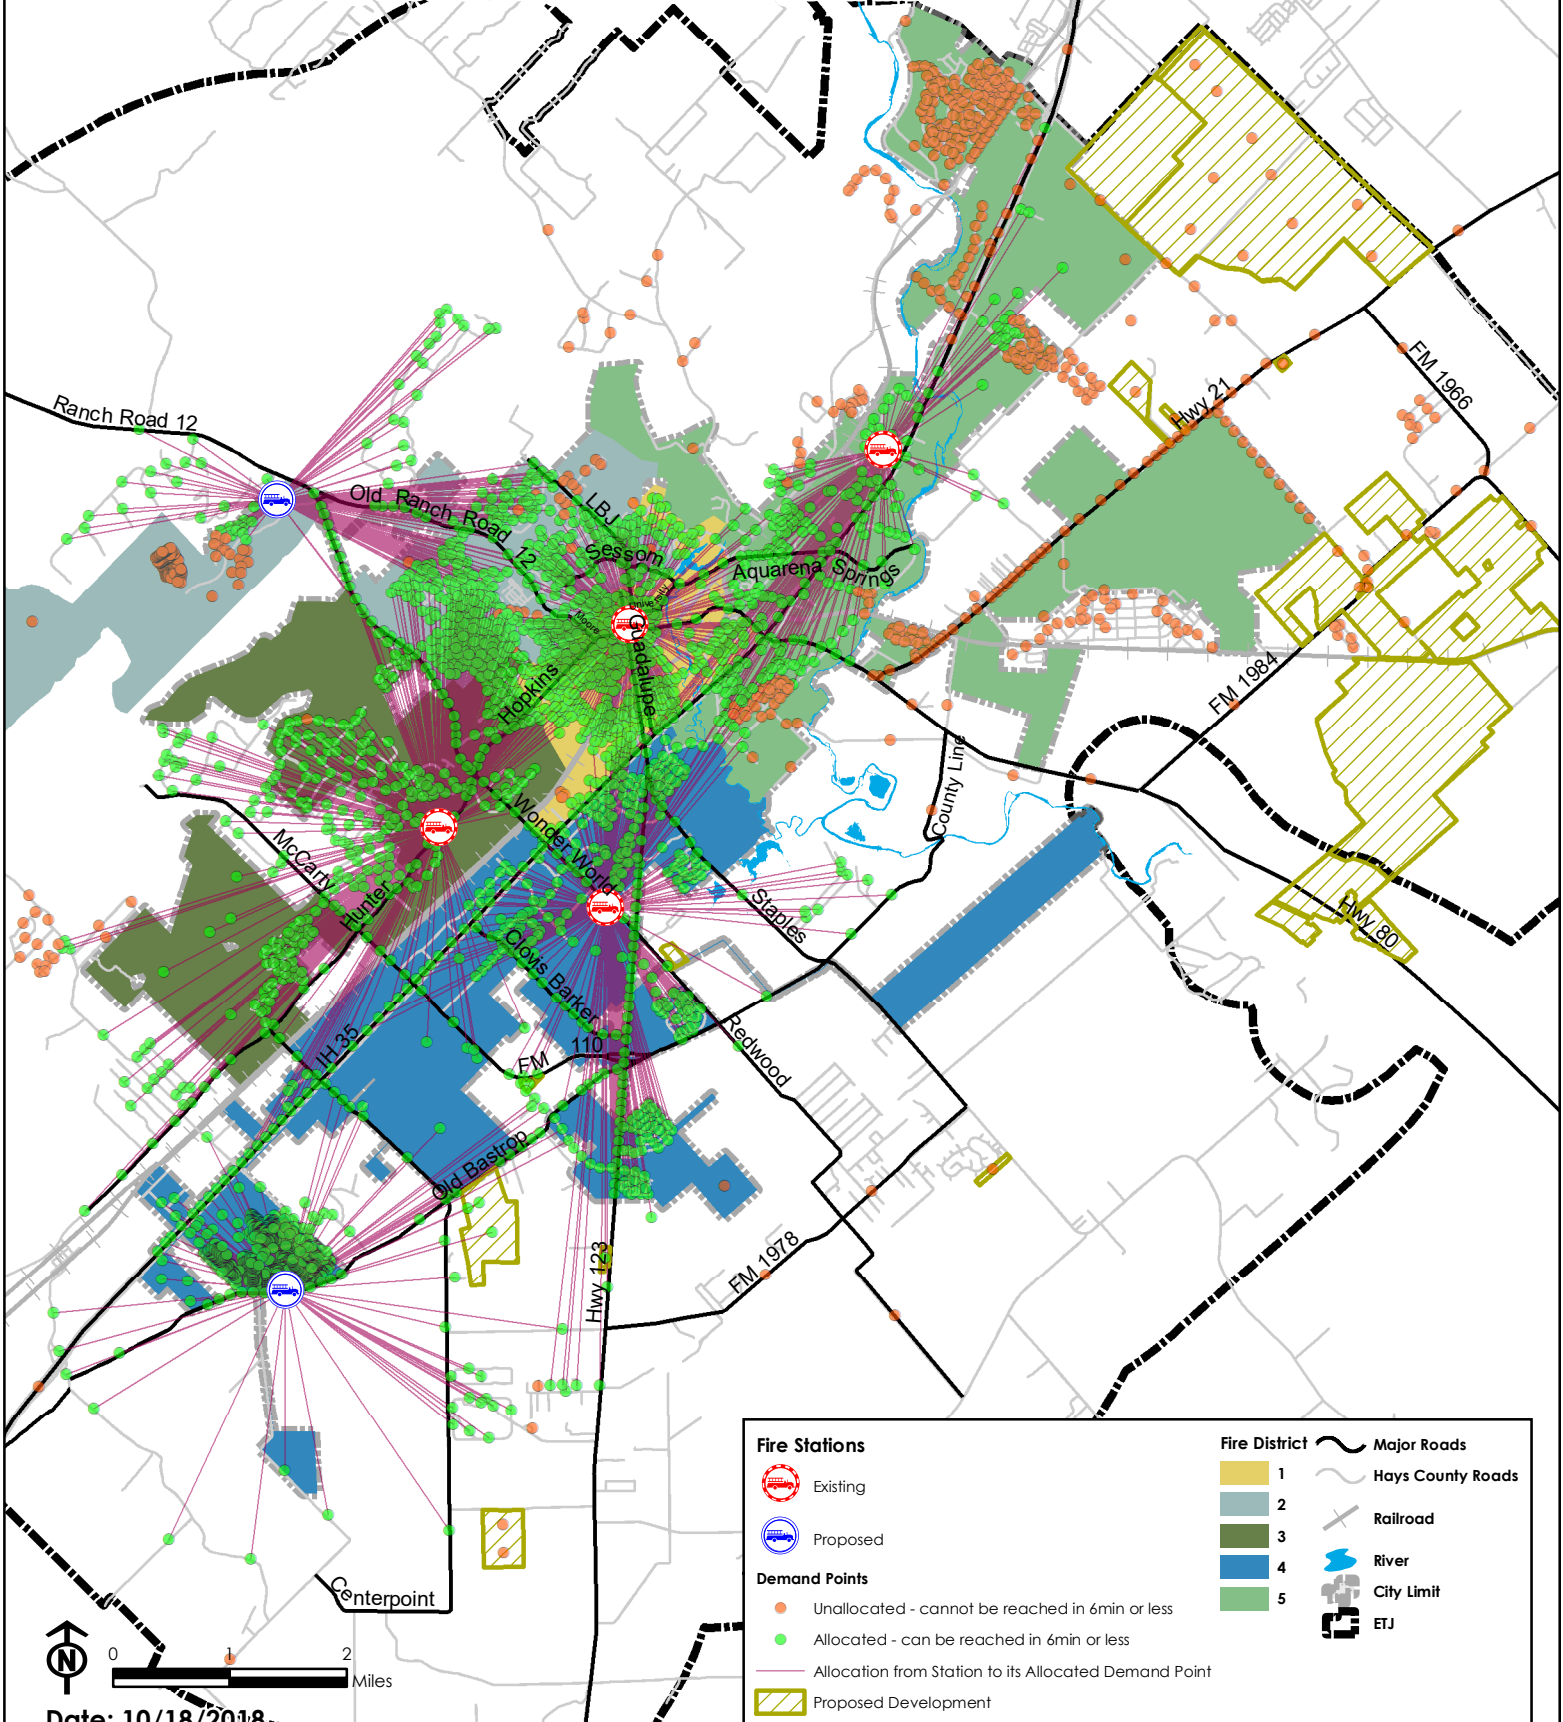

Date: 10/18/2018